

Residential Deck Information Sheet

Frost Proof Footings

Required for any deck or porch that is attached or unattached serving as an exit from a dwelling that has frost proof footings. The minimum depth to the base of the footing is 48" SPS 321.16.

Live Load

All decks shall be designed to support a live load of 40 pounds per square foot. SPS 321.02.

Guardrails

Required on all decks more than 24" above grade. The rail must be 36" minimum in height. Open guardrails and stair railings must have intermediate rails or an ornamental pattern that a 4" sphere cannot pass through. SPS 321.04 (3) (c).

Handrails

Stair flights of more than 3 risers must have at least one handrail for the full length of the stair flight. SPS 321.04 (3). The top of the handrail shall be at least 30" but not more than 38" above the nosing of the treads SPS 321.04 (3) (b). Handrail size & configuration shall follow SPS 321.04 (3) (b) 5.

Stairs

Minimum width is 36" SPS 321.04(2) (a). Maximum rise is 8" SPS 321.04 (2) (b). Minimum tread depth is 9" SPS 321.04 (2) (c). The greatest tread depth may not exceed the smallest tread depth by more than 3/8". The greatest riser height may not exceed the smallest riser height by more than 3/8" SPS 321.04 (2) (e).

Ramps

SPS 321.045 Slope shall not exceed 1 foot of rise in 8' of run.

Open Risers

SPS 321.04 (2) (f) Stairways with open risers shall be constructed to prevent the through-passage of a sphere with a diameter of 4 inches or larger between any two adjacent treads.

Cantilevers "Overhanging Joists & Beams"

Joists should not overhang beams by more than 2' SPS 321.22 (6) (b). Beams should not overhang support posts by more than 1' unless designed through structural analysis SPS 321.22 (3).

Framing Details

Header beams more than 6' and floor joists more than 8' long that frame into beams shall be supported by joist hangers or framing anchors, floor joists may be supported on ledger strips of at least 2" by 2" nominal. SPS 321.22 (7).

Bridging

Bridging or solid blocking shall be provided on floor joists 2x10 and greater, that are 8 feet or longer in length. SPS 321.22 (9).

Wood Required

All exposed wood used in the construction of decks is required to be decay resistant. This includes posts, beams, joists, decking, and railings. SPS 321.10.

Flashing

All connections between deck and dwelling shall be weatherproof. Any cuts in exterior finish shall be flashed. SPS 321.24 (3) (c) 5.

Nails & Screws

Use only stainless steel, high strength aluminum, or hot dipped galvanized. Approved nails must be used on joist hangers per manufacturer's specs.

Special Design Note

Some deck designs may not be appropriate should the placement of a hot tub, screen porch, or 3 season porch on the deck platform be a future consideration.

INSPECTIONS NEEDED

Footings need to be inspected before backfilling post or placement of concrete.

Construction Inspection required:

Footings need to be inspected before backfilling post or placement of concrete.
Prior to decking and after if deck is less than 2 feet from grade.
After completion if deck is more than 2 feet from grade.

Building Codes may be viewed at:

<http://dsps.wi.gov/sb/SB-DivCodesListing.html>
SPS 320-325 Uniform Dwelling (One and Two Family Dwelling)

Joist span

Based on No. 2 or better wood grades.
 (Design Load = 40#LL + 10#DL, Deflection= L/360)

	Ponderosa pine			Southern pine			Western cedar		
	12"OC	16"OC	24"OC	12"OC	16"OC	24"OC	12"OC	16"OC	24"OC
2x6	9-2	8-4	7-2	10-4	9-5	7-10	8-10	8-0	7-0
2x8	12-1	11-0	9-0	13-8	12-5	10-2	11-8	10-7	9-2
2x10	15-4	13-6	11-0	17-5	15-10	13-1	14-11	13-6	11-3
2x12	18-1	15-8	12-10	21-2	18-10	15-5	18-1	16-0	13-0

Sample calculations for using joist span, beam size and footing size tables

Case I solution:

Refer to tables for joist, beam and footing size requirements.




Example: a = 12 feet; Post spacing = 8 feet

Use the **joist span** table to find the acceptable joist sizes for a 12 foot span, 2x8s at 12 inches O.C., 2x10s at 16 inches O.C. or 2x12s at 24 inches O.C.

Use the **Beam and footing sizes** table and find the 8 foot post spacing column. With a 12 foot deck span, the beam may be either two 2x8s or two 2x10s, depending on the type of soil, the footing diameter at the base must be a minimum of 12 inches, 10 inches or 9 inches for the corner post and 17 inches, 14 inches or 12 inches for all intermediate posts.

Case II solution:

Use "a" to determine joist size and "a" + "2b" to determine beam and footing sizes. The length of "b" is restricted by both the length of "a" and the size of the joists.

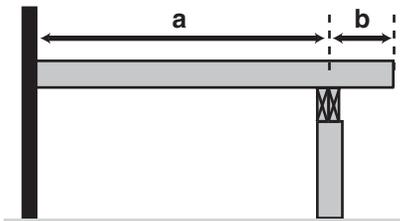


Example: a = 8 feet, b = 2 feet, Post spacing = 10 feet

Refer to the **joist span** table. For an 8 foot joist span, either 2x8s at 24 inches O.C. or 2x6s at 16 inches O.C. are acceptable.

For sizing the beam, use a joist length of 12 feet (8 feet + 4 feet) and a post spacing of 10 feet. The **beam and footing sizes** table indicates that the beam may be either two 2x10s or two 2x12s, depending on wood used. Depending on the type of soil, the footing diameter at the base must be a minimum of 15 inches, 12 inches or 11 inches for the corner post and 20 inches, 17 inches or 15 inches for all intermediate posts. Note that because of the 2 foot cantilever all footing sizes were increased by 1 inches as required by footnote 2 at the end of the table.

Case III solution:

Use "a" or "b", whichever is greater, to determine joist size. Use "a" + "b" to determine the size of Beam 1 and the post footing size for the posts supporting Beam 1. Use joist length "b" to determine both the size of Beam 2 and the post footing size for the posts supporting Beam 2.

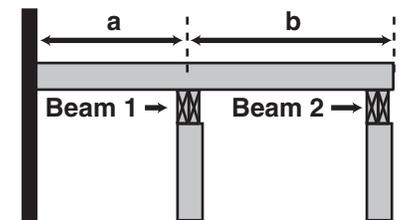

Example: a = 6 feet, b = 7 feet, Post spacing = 9 feet

Joist size is determined by using the longest span joist (7 feet). The **joist span** table indicates that 2x6s at 24" O.C. would be adequate for this span.

For Beam 1 and footings, use a joist length of 13 feet (6 feet + 7 feet) and a post spacing of 9 feet. The **beam and footing sizes** table indicates that the beam may be two 2x10s or two 2x12s, depending on the wood used. Depending on the type of soil, the footing diameters for Beam 1 posts shall be 13 inches, 11 inches or 9 inches for the corner (outside) post and 19 inches, 15 inches or 13 inches for all intermediate posts. For Beam 2 and footings use a joist length of 7 feet and post spacing of 9 feet. The beam may be two 2x8s or two 2x10s, depending on wood used. Depending on the type of soil, the footing diameters for Beam 2 shall be 10 inches, 8 inches or 7 inches for the corner posts, and 14 inches, 11 inches or 10 inches for all intermediate posts.

Beam and footing sizes

Based on No. 2 or better Ponderosa Pine and Southern Pine


		Post spacing										
		4'	5'	6'	7'	8'	9'	10'	11'	12'	13'	14'
6'	Southern Pine Beam	1-2x6	1-2x6	1-2x6	2-2x6	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x10	2-2x10
	Ponderosa Pine Beam	1-2x6	1-2x6	1-2x8	2-2x8	2-2x8	2-2x8	2-2x10	2-2x10	2-2x12	2-2x12	3-2x10
6'	Corner Footing	6 5 4	7 6 5	7 6 5	8 7 6	9 7 6	9 7 6	10 8 7	10 8 7	10 9 7	11 9 8	11 9 8
	Intermediate Footing	9 8 7	10 8 7	10 9 7	11 9 8	12 10 9	13 10 9	14 11 10	14 12 10	15 12 10	15 13 11	16 13 11
7'	Southern Pine Beam	1-2x6	1-2x6	1-2x6	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x10	2-2x10	2-2x12
	Ponderosa Pine Beam	1-2x6	1-2x6	1-2x8	2-2x8	2-2x8	2-2x10	2-2x10	2-2x10	2-2x12	3-2x10	3-2x10
7'	Corner Footing	7 5 5	7 6 5	8 7 6	9 7 6	9 8 7	10 8 7	10 8 7	11 9 8	11 9 8	12 10 9	12 10 9
	Intermediate Footing	9 8 7	10 8 7	11 9 8	12 10 9	13 11 9	14 11 10	15 12 10	15 13 11	16 13 11	17 14 12	17 14 12
8'	Southern Pine Beam	1-2x6	1-2x6	2-2x6	2-2x6	2-2x8	2-2x8	2-2x8	2-2x10	2-2x10	2-2x12	2-2x12
	Ponderosa Pine Beam	1-2x6	2-2x6	2-2x8	2-2x8	2-2x8	2-2x10	2-2x10	2-2x10	3-2x10	3-2x10	3-2x12
8'	Corner Footing	7 6 5	8 6 6	9 7 6	9 8 7	10 8 7	10 8 7	11 9 8	11 9 8	12 10 9	13 10 9	13 11 9
	Intermediate Footing	10 8 7	11 9 8	12 10 9	13 11 9	14 11 10	15 12 10	16 13 11	16 13 12	17 14 12	18 15 13	18 15 13
9'	Southern Pine Beam	1-2x6	1-2x6	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x10	2-2x12	2-2x12	3-2x10
	Ponderosa Pine Beam	1-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x10	2-2x10	3-2x10	3-2x10	3-2x12	3-2x12
9'	Corner Footing	7 6 5	8 7 6	9 7 6	10 8 7	10 9 7	11 9 8	12 10 8	12 10 9	13 10 9	13 11 9	14 11 10
	Intermediate Footing	10 9 7	12 10 8	13 10 9	14 11 10	15 12 10	16 13 11	17 14 12	17 14 12	18 15 13	19 15 13	20 16 14
10'	Southern Pine Beam	1-2x6	1-2x6	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x10	2-2x12	3-2x10	3-2x10
	Ponderosa Pine Beam	1-2x6	1-2x6	2-2x8	2-2x8	2-2x10	2-2x10	2-2x12	3-2x10	3-2x12	3-2x12	Eng Bm
10'	Corner Footing	8 6 6	9 7 6	10 8 7	10 8 7	11 9 8	12 10 8	12 10 9	13 11 9	14 11 10	14 12 10	15 12 10
	Intermediate Footing	11 9 8	12 10 9	14 11 10	15 12 10	16 13 11	17 14 12	17 14 12	18 15 13	19 16 14	20 16 14	21 17 15
11'	Southern Pine Beam	1-2x6	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x10	2-2x12	2-2x12	3-2x10	3-2x12
	Ponderosa Pine Beam	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x12	2-2x12	3-2x10	3-2x12	3-2x12	Eng Bm
11'	Corner Footing	8 7 6	9 7 6	10 8 7	11 9 8	12 9 8	12 10 9	13 11 9	14 11 10	14 12 10	15 12 10	15 13 11
	Intermediate Footing	12 9 8	13 11 9	14 12 10	15 12 10	16 13 11	17 14 12	17 14 12	18 15 13	19 16 14	20 16 14	21 17 15
12'	Southern Pine Beam	1-2x6	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x10	2-2x12	3-2x10	3-2x10	3-2x12
	Ponderosa Pine Beam	2-2x6	2-2x6	2-2x8	2-2x10	2-2x10	2-2x12	2-2x12	3-2x12	3-2x12	Eng Bm	Eng Bm
12'	Corner Footing	9 7 6	10 8 7	10 9 7	11 9 8	12 10 9	13 10 9	14 11 10	14 12 10	15 12 10	15 13 11	16 13 11
	Intermediate Footing	12 10 9	14 11 10	15 12 10	16 13 11	17 14 12	18 15 13	19 16 14	20 16 14	21 17 15	22 18 15	23 18 16
13'	Southern Pine Beam	1-2x6	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x10	2-2x12	3-2x10	3-2x12	3-2x12
	Ponderosa Pine Beam	2-2x6	2-2x6	2-2x8	2-2x10	2-2x12	2-2x12	2-2x12	3-2x12	3-2x12	Eng Bm	Eng Bm
13'	Corner Footing	9 7 6	10 8 7	11 9 8	12 10 8	13 10 9	13 11 9	14 12 10	15 12 10	15 13 11	16 13 11	17 14 12
	Intermediate Footing	13 10 9	14 12 10	15 13 11	17 14 12	18 15 13	19 15 13	20 16 14	21 17 15	22 18 15	23 19 16	24 19 17
14'	Southern Pine Beam	1-2x6	2-2x6	2-2x6	2-2x8	2-2x10	2-2x10	2-2x12	3-2x10	3-2x12	3-2x12	3-2x12
	Ponderosa Pine Beam	2-2x6	2-2x8	2-2x8	2-2x10	2-2x12	3-2x10	3-2x12	3-2x12	Eng Bm	Eng Bm	Eng Bm
14'	Corner Footing	9 8 7	10 8 7	11 9 8	12 10 9	13 11 9	14 11 10	15 12 10	15 13 11	16 13 11	17 14 12	17 14 12
	Intermediate Footing	13 11 9	15 12 10	16 13 11	17 14 12	18 15 13	20 16 14	21 17 15	22 18 15	23 18 16	24 19 17	24 20 17
15'	Southern Pine Beam	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x12	2-2x12	3-2x10	3-2x12	3-2x12	Eng Bm
	Ponderosa Pine Beam	2-2x6	2-2x8	2-2x8	2-2x10	3-2x10	3-2x10	3-2x12	3-2x12	Eng Bm	Eng Bm	Eng Bm
15'	Corner Footing	10 8 7	11 9 8	12 10 8	13 10 9	14 11 10	14 12 10	15 12 11	16 13 11	17 14 12	17 14 12	18 15 13
	Intermediate Footing	14 11 10	15 12 11	17 14 12	18 15 13	19 16 14	20 17 14	21 17 15	22 18 16	23 19 17	24 20 17	25 21 18
16'	Southern Pine Beam	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x12	2-2x12	3-2x10	3-2x12	3-2x12	Eng Bm
	Ponderosa Pine Beam	2-2x6	2-2x8	2-2x10	2-2x10	3-2x10	3-2x10	3-2x12	3-2x12	Eng Bm	Eng Bm	Eng Bm
16'	Corner Footing	10 8 7	11 9 8	12 10 9	13 11 9	14 11 10	15 12 10	16 13 11	16 13 12	17 14 12	18 15 13	18 15 13
	Intermediate Footing	14 11 10	16 13 11	17 14 12	18 15 13	20 16 14	21 17 15	22 18 16	23 19 16	24 20 17	25 21 18	26 21 18

Notes:

- Joist length is total length of joist, **including** any cantilevers.
- When joist extends (cantilevers) beyond support beam by 18 inches or more, add 1 inches to footing dimensions shown.
- Requirements for future 3-season porches or screen porches:
 - Increase corner footing size shown by 90%.
 - Increase center footing size shown by 55%.
 - Locate all footings at extremities of deck (no cantilevers).

d. Beam sizes indicated need not be altered.

4. All footing sizes above are base diameters (in inches) and are listed for THREE SOIL TYPES:

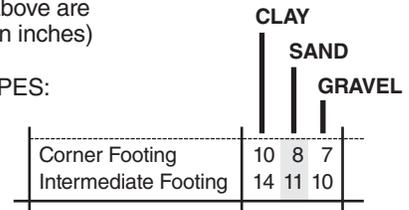


GUIDE TO LEDGER ATTACHMENT

NUMBER OF LAG SCREWS FOR DECK LEDGER (1)								
CLEAR SPAN	3/8" LAG		1/2" LAG		LedgerLok (A)		Simpson Strong-tie 1/4" SDS (B)	
	16" O.C.	24" O.C.	16" O.C.	24" O.C.	16" O.C.	24" O.C.	16" O.C.	24" O.C.
6 FEET	2	3	2	2	1	2	1	2
8 FEET	3	4*	2	3	2	2	2	2
10 FEET	3	5*	2	3	2	3	2	3
12 FEET	4*	5*	3	4*	2	3	2	3
14 FEET	4*	6*	3	4*	2	3	3	4


- (1) Southern Yellow Pine ledger and conventionally wood framed structure with sawn joists or wood trusses.
- (2) 40 pounds per square foot live load and 15 pounds per square foot dead load.
- (A) FastenMaster® LedgerLok™ Ledger Board Fastener, see ICC, EST-1078. This evaluation report does not address fastener corrosion when the fastener is installed in chemically treated wood.
<http://www.olyfast.com/pdf/LedgerLok%20Ad%20HIE.pdf>.
- (B) Simpson Strong-drive S-series Wood Screw, see ICC ER 5268. The double-barrier coating finish provides corrosion resistance superior to hot-dip galvanization, see their web site. <http://www.storntie.com/products/connectors/screws.html>.

* Excessive Application of screws into the ledger board may cause deck/ledger failure, other fasters listed recommended. In a board 2X10 or less, 4 screws may be a problem.

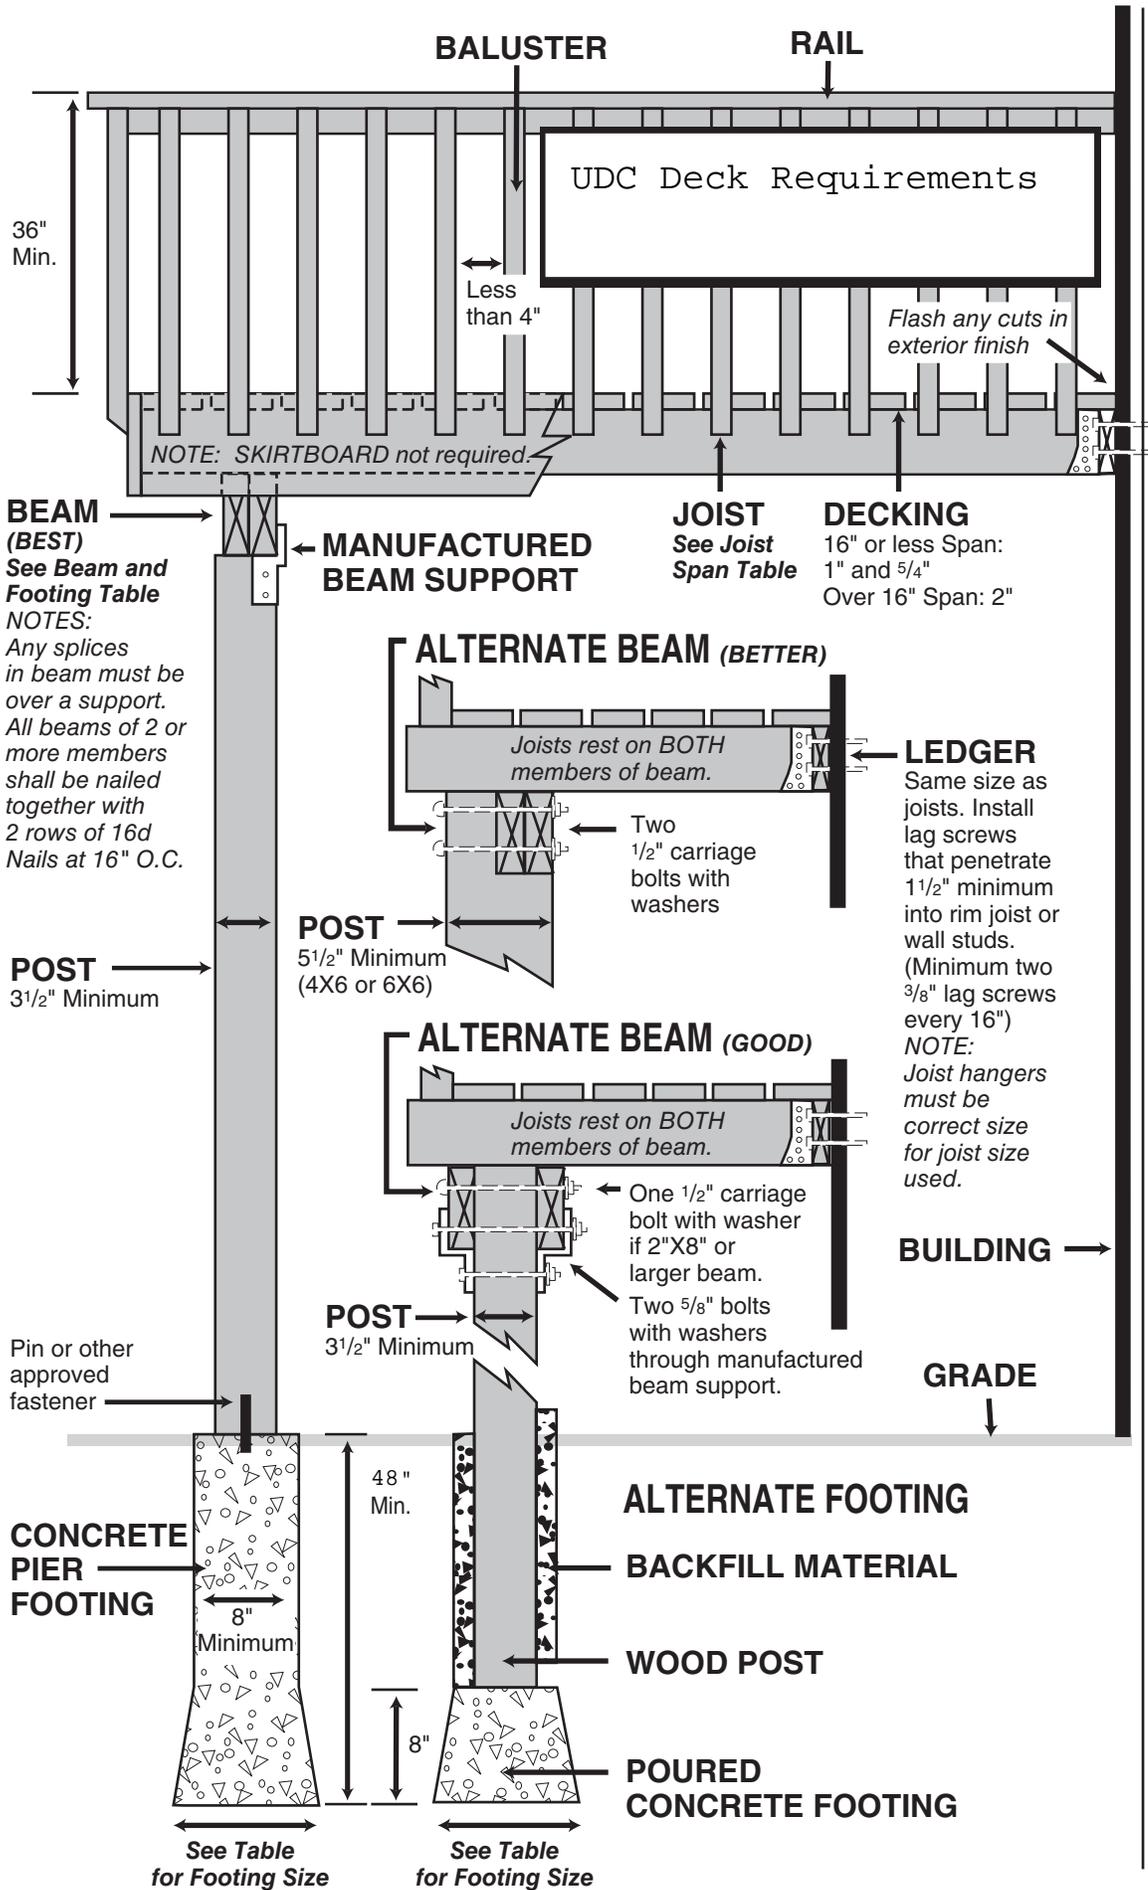



21.04 (3) (b) 5. HANDRAIL SHAPES

ROUND

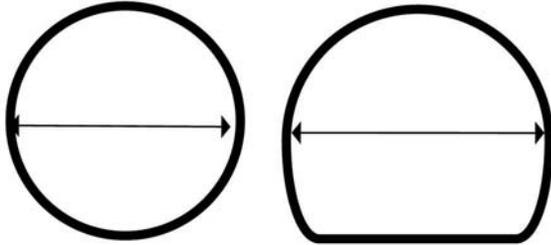

MAXIMUM 2"
DIAMETER

RECTANGULAR

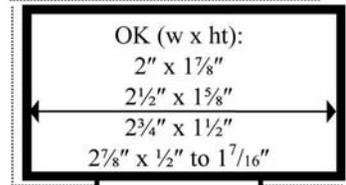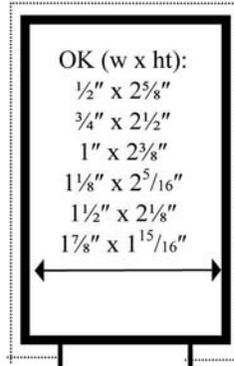

MAXIMUM 2 7/8"
CROSS SECTION

Maximum 6 1/4"
gripping surface
including
minimum 1/4" recess
on each side

OTHERS

